



Kristu Jayanti College

AUTONOMOUS

Bengaluru

Reaccredited 'A' Grade by NAAC | Affiliated to Bengaluru North University

7.1.3 Management of Degradable and Non-degradable Waste Waste Recycling System


7.1.3. Waste Recycling System

Sewage Treatment Plant – Recycling of Waste Water



Tertiary Sewage Treatment Plant of 90,000 litres Capacity

STP Flow Chart

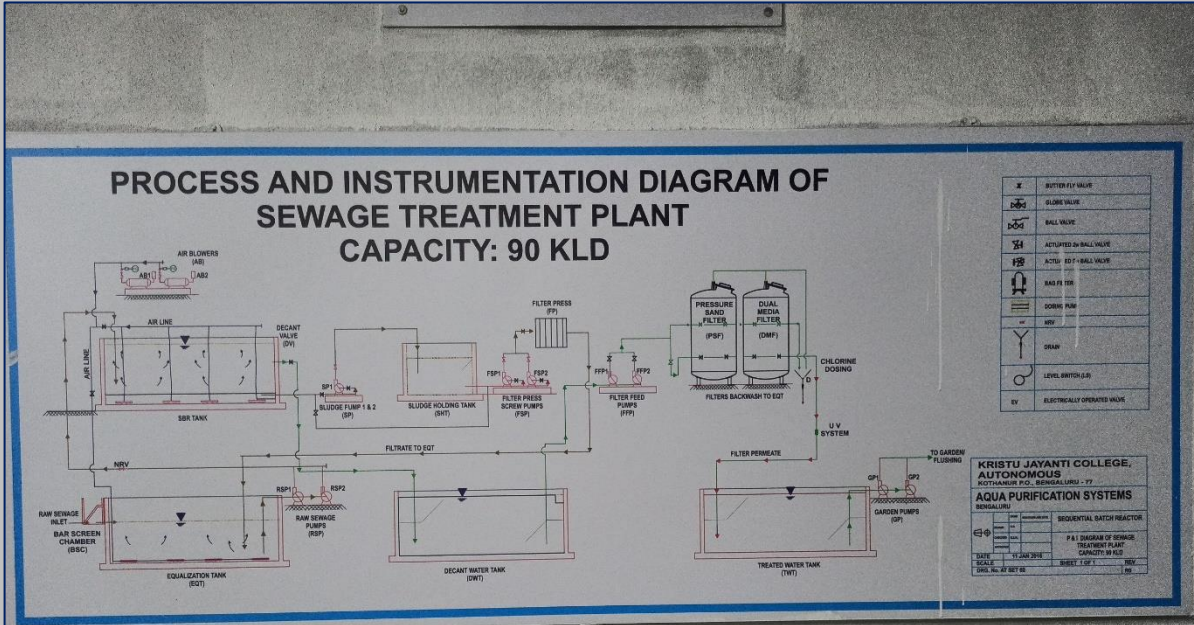

Latitude: 13.059932
 Longitude: 77.638399
 Accuracy: 500.0 m
 Time: 17-12-2020 16:33
 Note: STP flow chart



7.1.3. Waste Recycling System

Sewage Treatment Plant – Recycling of Waste Water



Tertiary Sewage Treatment Plant of 90,000 litres Capacity



Latitude: 13.059932
Longitude: 77.638399
Accuracy: 500.0 m
Time: 17-12-2020 16:37
Note: STP



Latitude: 13.060122
Longitude: 77.642337
Accuracy: 500.0 m
Time: 17-12-2020 16:36
Note: STP



Latitude: 13.060122
Longitude: 77.642337
Accuracy: 500.0 m
Time: 17-12-2020 16:35
Note: STP

7.1.3. Waste Recycling System- Usage of Recycled Water



Gardening



Latitude: 13.058309
Longitude: 77.642324
Elevation: 925.18 m
Accuracy: 14.0 m
Time: 19-12-2020 11:32
Note: Recycled water for gardening

7.1.3. Waste Recycling System- Usage of Recycled Water



Dual Plumbing for Flushers



Dual –Flush Toilet



7.1.3. Waste Recycling System

Recycled material use for Promotion of Programmes



Kristu Jayanti College

AUTONOMOUS

Bengaluru

Reaccredited 'A' Grade by NAAC | Affiliated to Bangalore North University



7.1.3. Waste Recycling System

Recycled material use for Promotion of Programmes



7.1.3. Waste Recycling System

Recycled material use for Promotion of Programmes

